


**III. Internal Corrosion
Direct Assessment of
Gas Transmission Lines**

Predicting Holdup

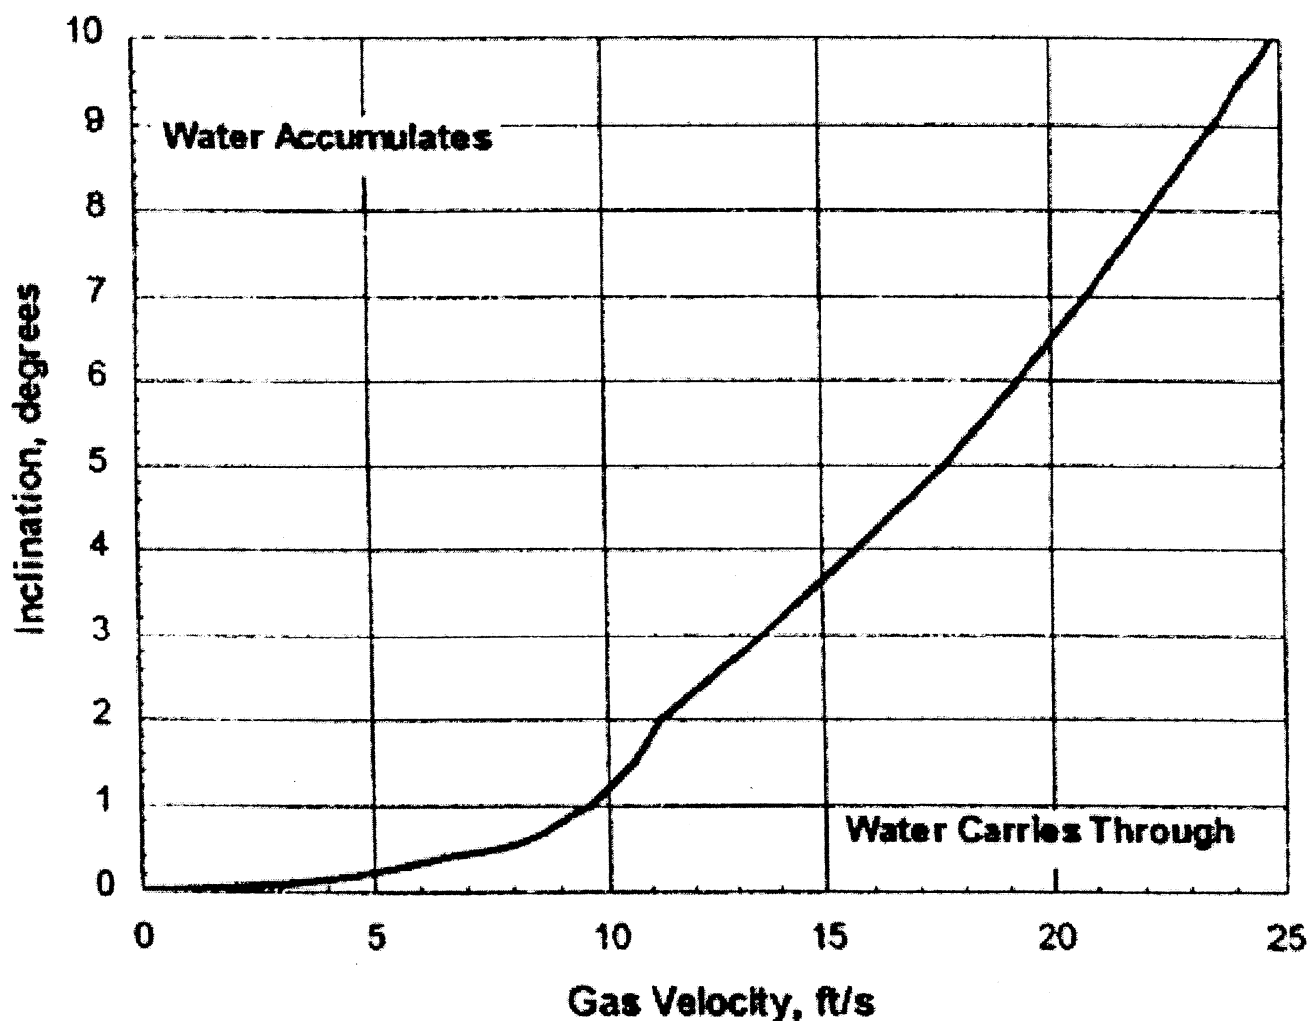

Simple spreadsheet to calculate critical angle for liquid hold-up. Line diameter, pressure, and temperature are data inputs.

Graph E. III.1 Critical Angle for Liquid Hold-up

Issued in Washington, DC on January 22, 2003.

Stacey L. Gerard,

Associate Administrator for Pipeline Safety.

[FR Doc. 03-603 Filed 1-27-03; 8:45 am]

BILLING CODE 4910-60-C