


Figure 1. Test Apparatus for Self-Contained Equipment

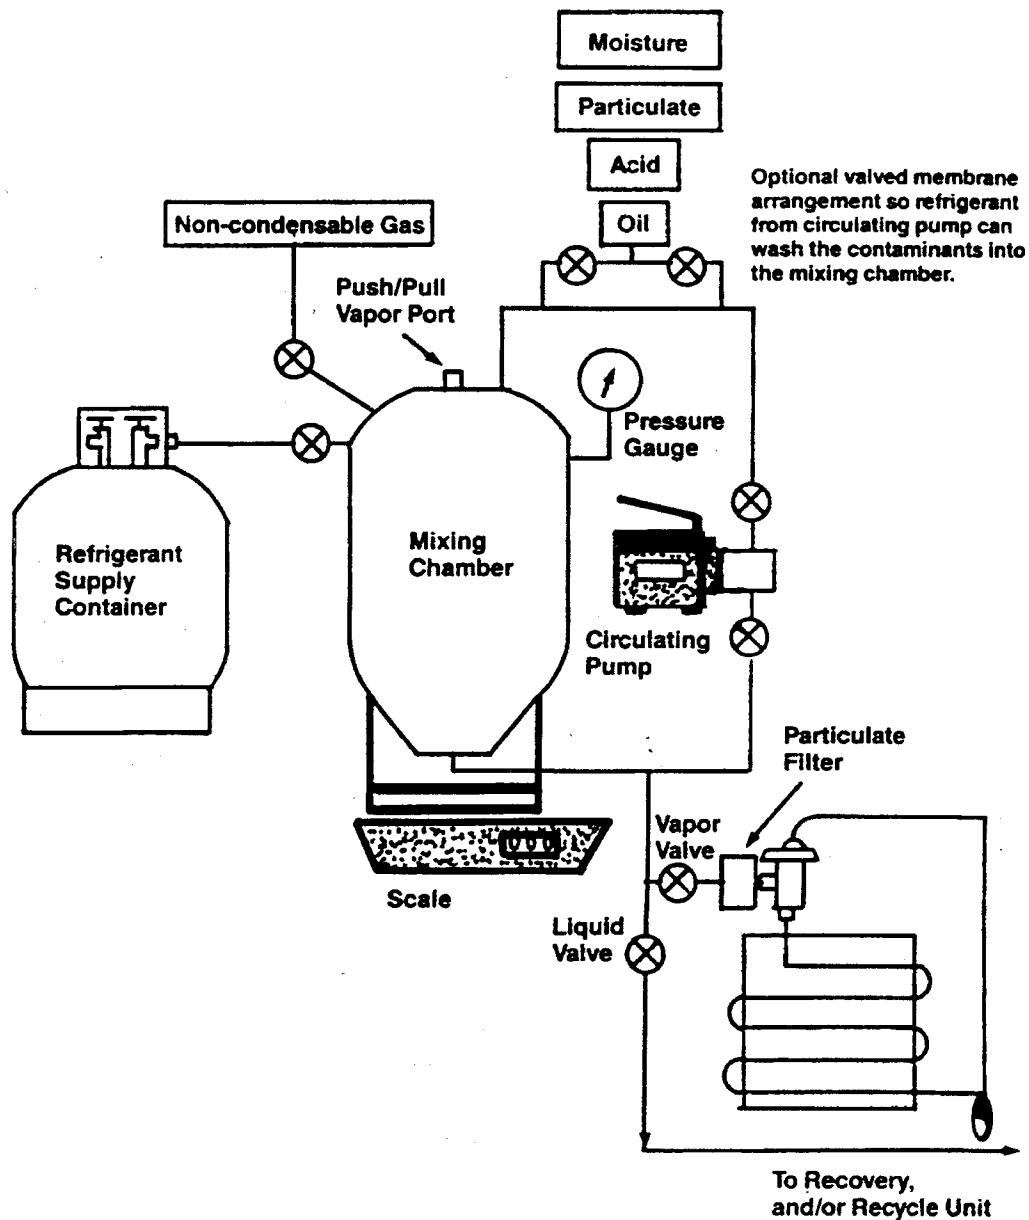

BILLING CODE 6560-50-C

6.3 *Size.* The size of the mixing chamber shall be a minimum of .09 m³. The bottom port and the refrigerant feed shall depend on

the size of the equipment. Typically, the mixing valves and piping shall be 9.5 mm. For large equipment to be used on chillers, the minimum inside diameter of ports, valves

and pipings shall be the smaller of the manufacturer's recommendation or 37 mm.

6.4 *System Dependent Equipment Test Apparatus.* This test apparatus is to be used