


Figure IV-4. Cumulative Percentage of HAA5 LRAAs for Surface Water Plants^{1,2}.

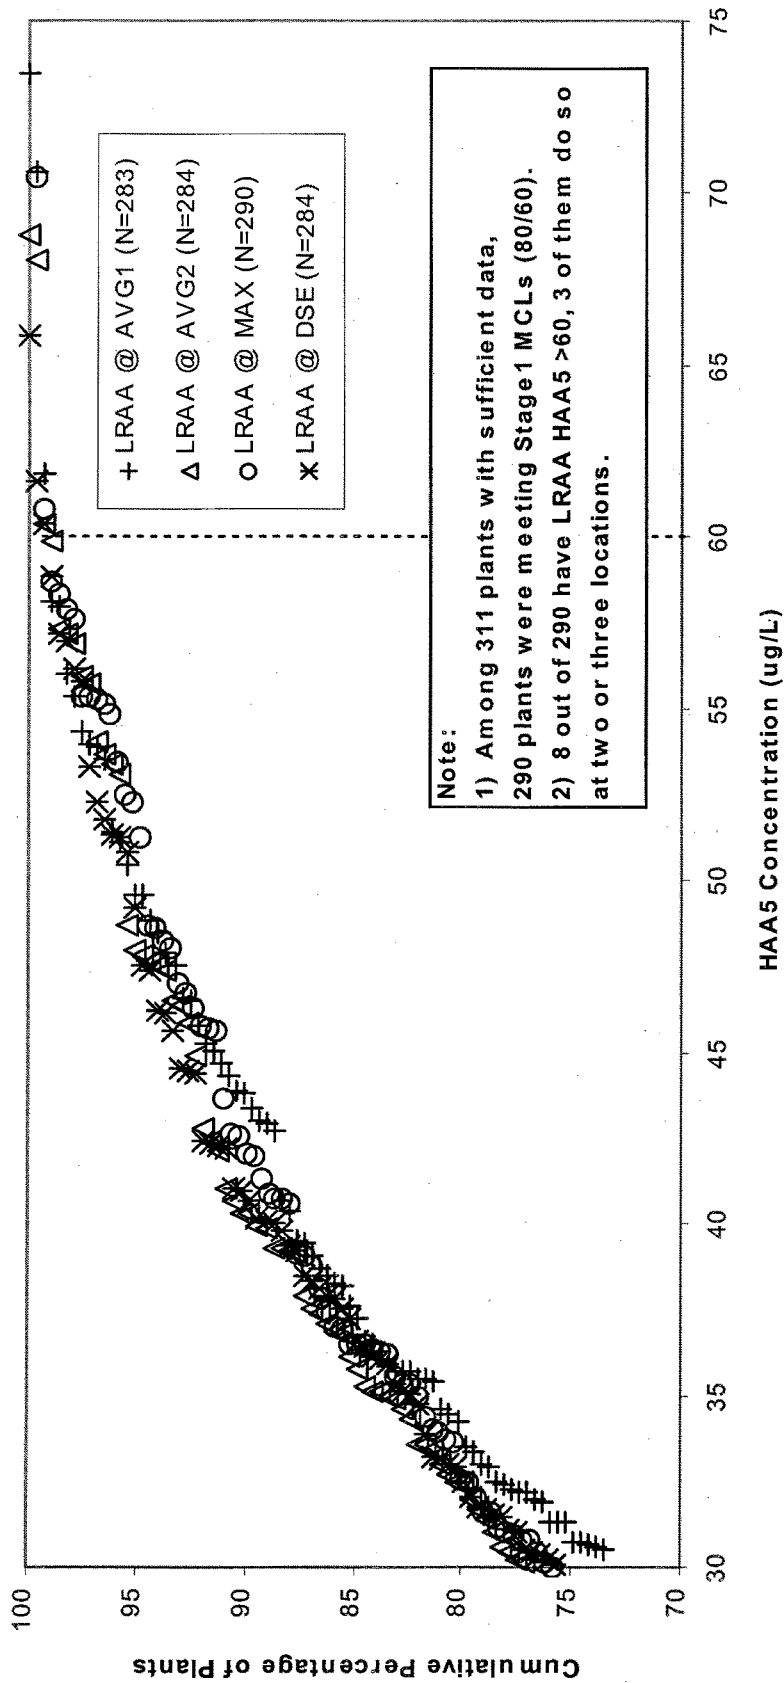

¹ The data shown are for surface water plants that would not exceed the Stage 1 DBPR TTHM and HAA5 MCLs when calculated using the last 4 quarters of Information Collection Rule data.

² Includes only the Information Collection Rule plants with at least 3 quarters of data and with each quarter having at least 3 sampling locations for both TTHM and HAA5 during the last 4 quarters of the Information Collection Rule sampling period.